


## vănEE 70E+ ERV

### Part no. 41802

Low speed: 50 CFM (0.2 in. w.g.), selectable 65 CFM

High speed: 100 CFM (0.4 in. w.g.), selectable 85 CFM

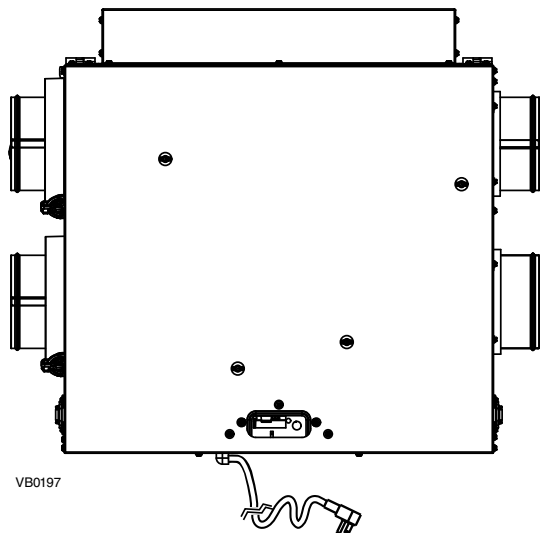

VB0197

### CONSTRUCTION

- 22 ga. galvanized steel housing
- 22 ga. pre-painted steel door
- One-piece molded insulation shell, (expanded polystyrene; UL 94 HF-1 certified)
- Galvanized steel 5" diameter ports\*
- Steel door hinges and latches
- Cold side ports with plastic ring; allow vapor barrier sealing
- No drain required
- Included installation brackets

\*All units ports were created to be connected to ducts having a minimum of 5" diameter, but if need be, they can be connected to bigger sized ducts by using an appropriate transition (e.g.: 5" diameter to 6" diameter transition).

### MOTORS

- Two high reliability, external rotor PSC motors, totally enclosed and thermally protected
- Backward blowers, can support high static pressure environment

### FILTERS

- Two washable 20 ppi reticulated polyester urethane foam filters, UL 900 class 2 certified
- Optional MERV 8 filter kit, part no. 21030 (additional 0.1 in. w.g. static pressure to be considered) (sold separately)

### ERV CORE

- Crossflow aluminum-polymerized paper core, UL723 certified
- Hydroscopic polymer exchange water by direct vapor transfer using molecular transport without the need of condensation
- Constructed of alternate layers of corrugated aluminum material and polymeric bactericide dessiccant impregnated media; will not promote growth of mold or bacteria
- Unique rectangular flute design to provide very low pressure drop values

## ENERGY RECOVERY VENTILATOR

### Controls

- Use a main wall control (not included) to operate the unit. For a complete list of main and optional auxiliary controls available, refer to the **Wall Control Compatibility Chart** on last pages of wall controls specification sheet, available at [www.vanee.ca](http://www.vanee.ca)
- For more details about controls, refer to the **Main and auxiliary wall controls** user guide, also available at [www.vanee.ca](http://www.vanee.ca)
- Removable terminal block included for quicker low voltage control connections
- LED indicator shows error codes
- Unit must be permanently energized, no control should be installed on power supply of unit

### Air Flow

- Pressure taps and balancing chart to allow easier balancing of the unit
- Integrated balancing dampers in cold supply and cold exhaust ports
- Integrated motorized damper adjacent to the cold supply port
- Integrated backdraft damper in cold exhaust port

### Defrosting System

- Equipped with Homeshield™ defrosting system: recirculation defrost cycle to maintain balanced air pressure in the dwelling unit
- A switch on ERV unit allows 3 quick-access defrost modes, a LED shows which defrost mode has been chosen:
  - Standard (factory set regular mode)
  - Plus (extended defrost for colder areas)
  - Discretion (keeps the same speed when performing defrost as performing ventilation)

OUTSIDE TEMPERATURE*		DEFROST CYCLES		
		DEFROST IN MINUTES / AIR EXCHANGE IN MINUTES		
°C	°F	STANDARD	PLUS	DISCRETION
WARMER THAN -10	WARMER THAN 14	No DEFROST	No DEFROST	No DEFROST
FROM -10 TO -15	FROM 14 TO 5	8/50	10/30	16/50
FROM -15 TO -27	FROM 5 TO -17	8/25	10/20	16/25
-27 AND LESS	-17 AND LESS	10/22	10/15	20/22

\* Outside temperature is read by a thermistor located inside the unit, next to fresh air from outside port.

### Warranty


The vănEE 70E+ ERV is protected by a 5-year warranty on parts only, with the original proof of purchase.

### Requirements and standards

- HVI certified
- ENERGY STAR® qualified
- Complies with the UL 1812 requirements regulating the installation of Energy Recovery Ventilators
- Complies with the CSA C22.2 no. 113 Standard applicable to ventilators
- Complies with CSA F326 requirements regulating the installation of Energy Recovery Ventilators




# VANE 70E+ ERV

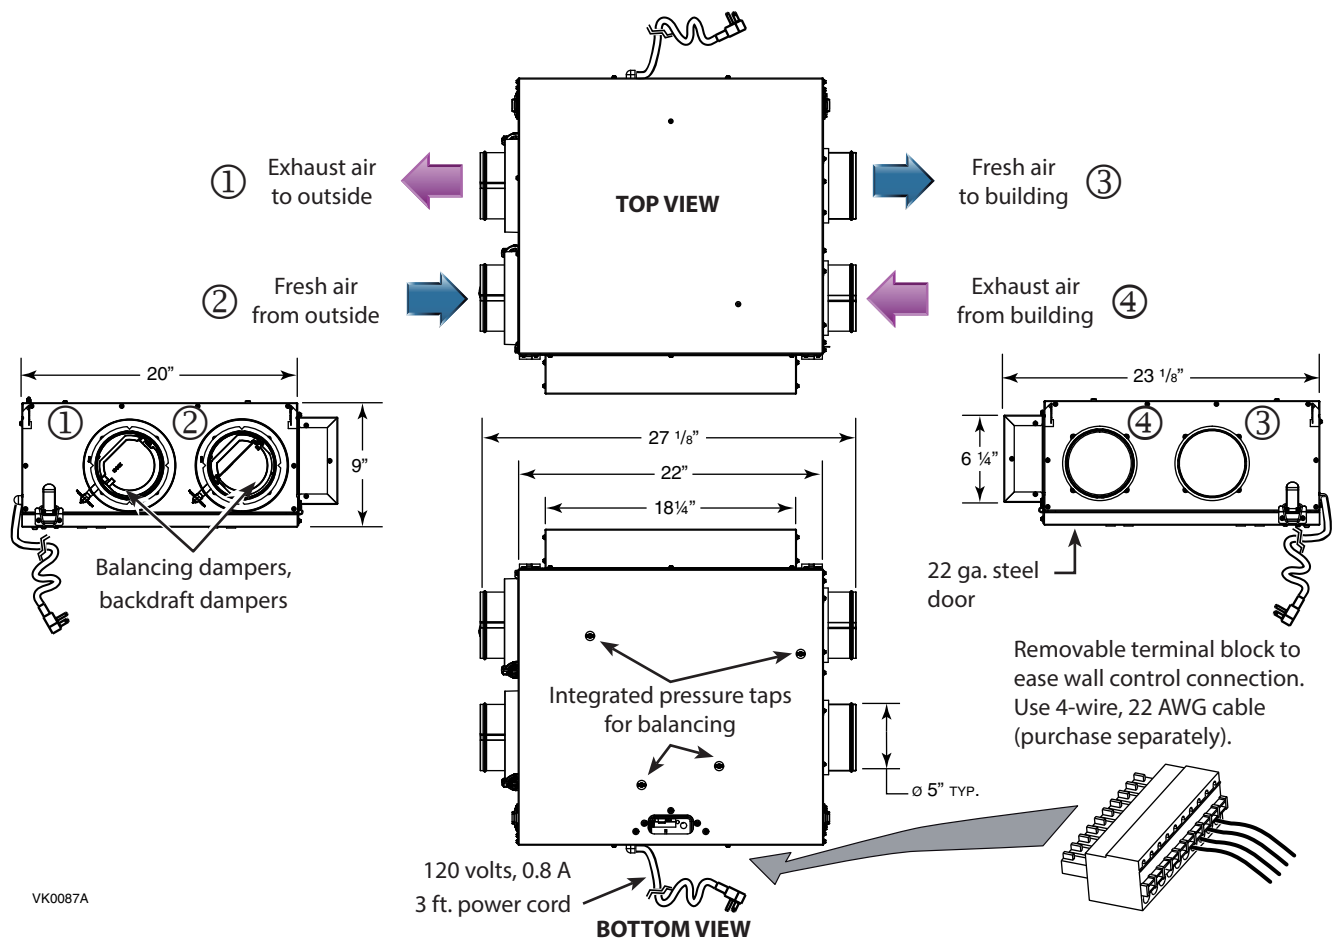


## HORIZONTAL INSTALLATION ONLY

Allow 24" x 30" minimum for access door.

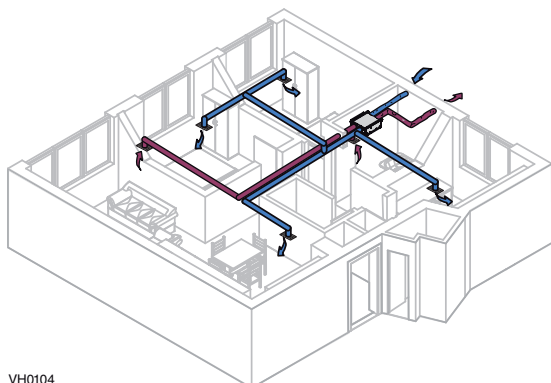

Example of a fully ducted installation

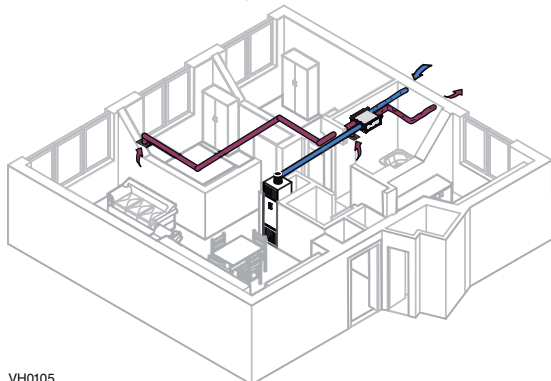


Example of a central draw point installation


## UNIQUE 3 EASY STEPS FOR CEILING INSTALLATION

- 1 Mount brackets to ceiling.
  - 2 Bend integrated hooks (2 on the same side) and hang the unit.
  - 3 Clip the other side of the unit to the brackets.
- Integrated dampening device to prevent vibration transmission
- VO0255


## OR ALTERNATE INSTALLATION

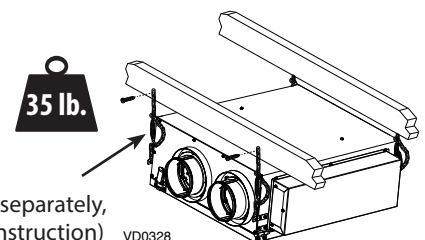


## Simplified Installation (connection to a forced air system)

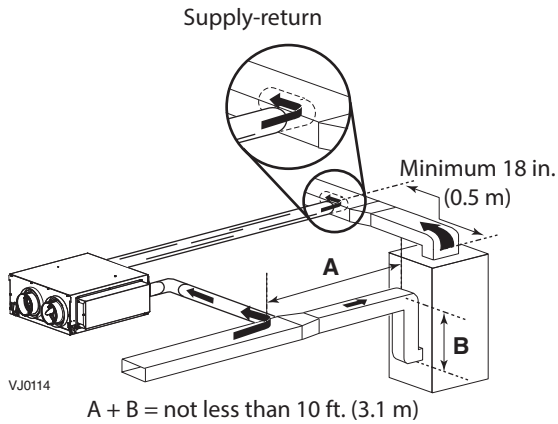

OR

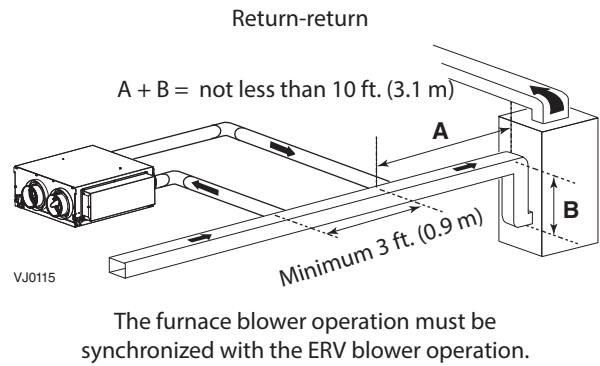

## VENTILATION PERFORMANCE

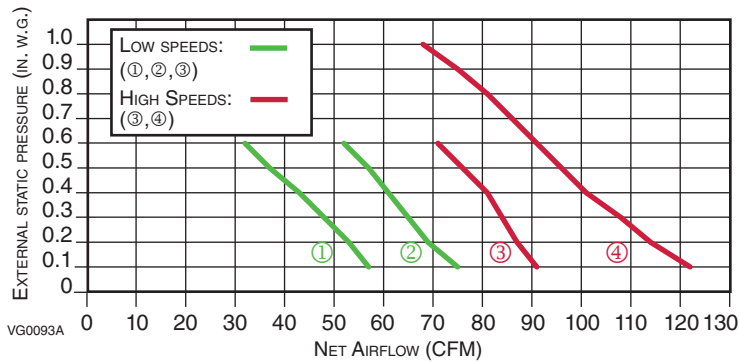

NOTE: Low speed ① and high speed ④ are factory set, low speed ② and high speed ③ are selectable.

## ENERGY PERFORMANCE

SUPPLY TEMPERATURE		NET AIR FLOW			POWER CONSUMED WATTS	SENSIBLE RECOVERY EFFICIENCY	ADJUSTED SENSIBLE RECOVERY EFFICIENCY	APPARENT SENSIBLE EFFECTIVENESS*	LATENT RECOVERY/MOISTURE TRANSFER
°C	°F	L/S	CFM	M³/H					
HEATING									
0	32	23	48	82	40	67	71	75	0.55
0	32	31	65	110	54	65	70	73	0.51
0	32	40	85	144	68	61	66	69	0.47
-25	-13	23	48	82	55	61	64	76	0.59
-25	-13	31	65	110	70	60	62	73	0.54
COOLING						TOTAL RECOVERY EFFICIENCY		ADJUSTED TOTAL RECOVERY EFFICIENCY	
35	95	23	48	82	40	54		57	

\*Data not certified by HVI.

NOTE: All specifications are subject to change without notice.

## Accoustic Noise Power Chart (dBA)


Airflow	Fresh air to building port	Exhaust air from building port
100 CFM at 0.4 in. w.g.	69.0 dBA	58.1 dBA
55 CFM at 0.1 in. w.g.	59.3 dBA	49.8 dBA

The data shown on left chart come from measurement performed according to ISO 5136 Standard. These data represent the sound power directly measured at the fresh air distribution port and exhaust air from building port. To get the actual noise level in the room, consider noise attenuation resulting from total ductwork installation.

## Coldshield™ Protection

### ERV UNIT MODES BASED ON SUPPLIED AIR TEMPERATURE

- ERV unit is equipped with an electronic supplemental protection to stop air distribution in dwelling if air distribution temperature drops below freezing point, due to abnormal conditions.

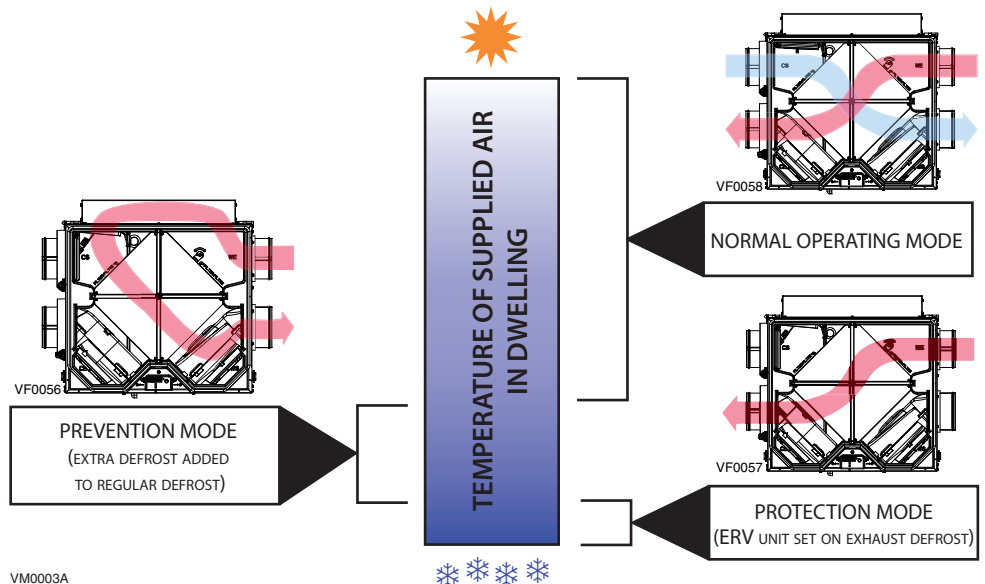

# VÄNEE 70E+ ERV ARCHITECTURAL SPECIFICATIONS

## AIRFLOW

- High static pressure backward blowers shall perform a minimum of 68 CFM @ 1.0 in. w.g.
- Optional high speed: 85 CFM
- Optional low speed: 65 CFM

## CONSTRUCTION

- Housing shall be made of 22 ga. galvanized steel
- Door shall be made of 22 ga. pre-painted steel
- Insulation shall be made of one-piece molded expanded polystyrene, UL 94 HF-1 certified
- 5" diameter ports shall be made of galvanized steel
- Door hinges and latches shall be made of steel
- Cold side ports shall have plastic ring to allow vapor barrier sealing
- Unit construction and components shall be UL and CSA certified
- Unit shall operate all year long without drain
- Weight shall not exceed 35 lb.
- Fresh air from outside and Exhaust air to outside ports shall be located on same side
- Backdraft damper shall be integrated in cold exhaust ports
- ERV unit shall be HVI certified and ENERGY STAR® qualified

## MOTORS

- Unit shall have two high reliability, external rotor PSC motors, totally enclosed and thermally protected
- The backward blowers shall support high static pressure environment
- The insulation class shall be B

## FILTERS

- ERV unit shall have two washable 20 ppi reticulated polyester urethane foam filters, UL 900 class 2 certified
- Optional MERV 8 filter kit, part no. 21030

## ERV CORE

- The ERV core shall be a crossflow aluminum-polymerized paper core, UL723 certified
- Hydroscopic polymer exchange water by direct vapor transfer shall use molecular transport without the need of condensation
- The ERV core shall be constructed of alternate layers of corrugated aluminum material and polymeric bactericide dessiccant impregnated media; and shall not promote growth of mold or bacteria
- The ERV core design shall be made of rectangular flutes to provide very low pressure drop values

## Controls

- Choice of low voltage main controls (not included) shall be energized by ERV unit
- Optional low voltage auxiliary controls (not included) shall be energized by ERV unit
- Removable terminal block shall be included for quicker low voltage control connections
- A LED indicator shall indicate defrost selected mode as well as error codes
- ERV unit shall be permanently energized, no control shall be installed on power supply of unit

## Air Flow Balancing

- Unit door shall be equipped with pressure taps as well as a balancing chart to allow verification of balancing of the ERV unit
- Balancing damper shall be integrated in cold supply and cold exhaust ports
- Motorized damper shall be integrated in ERV unit, adjacent to the cold supply port

## Defrosting System

- Unit shall allow 3 quick-access defrost modes:
  - Standard (factory set regular mode)
  - Plus (extended defrost for colder areas)
  - Discretion (keeps the same speed when performing defrost as performing ventilation)
- Unit shall be equipped with Coldshield™ protection to stop air supply in dwelling if air supply temperature drops below freezing point, due to abnormal conditions.

## Acoustic Noise Power

- The unit shall have a maximum acoustic noise power of 59.3 dBA on low speed at 0.1 in. w.g. and 69.0 dBA on high speed at 0.4 in. w.g., measured at fresh air to building port.
- The unit shall have a maximum acoustic noise power of 49.8 dBA on low speed at 0.1 in. w.g. and 58.1 dBA on high speed at 0.4 in. w.g., measured at exhaust air from building port.

## Warranty

Unit shall be protected by a 5-year warranty on parts only, with the original proof of purchase.

## Requirements and standards

- Shall be HVI certified as per CSA C439 Standards
- Shall be ENERGY STAR® qualified
- Shall comply with the UL 1812 requirements regulating the installation of Energy Recovery Ventilators
- Shall comply with the CSA C22.2 no. 113 Standard applicable to ventilators
- Shall comply with CSA F326 requirements regulating the installation of Energy Recovery Ventilators

Project:	REMARKS
Location:	
Part no.: 41802	
Qty.:	
Submitted by: _____ Date: _____	



Residential Products Group, 550 Lemire Blvd., Drummondville, Qc, Canada J2C 7W9 - Tel.: 1-800-567-3855 Fax: 1-800-567-1715



www.vanee.ca

70E+ ERVd191023